



- NOTES:
- 1) ASTM 325 ERECTION BOLTS
 - 2) ALL HOT DIP GALVANIZED AFTER FABRICATION (ASTM A123)
 - 3) ALL HOLES 11/16" DIA. FOR 5/8" DIA. BOLTS UNLESS NOTED
 - 4) PIECE MARK STAMPED INTO METAL WITH NOT LESS THAN 3/8" HIGH CHARACTERS BEFORE GALVANIZING
 - 5) ALL WELDING ELECTRODES SHALL BE E7021
 - 6) EDGE DISTANCE 1" UNLESS NOTED

BILL OF MATERIAL				
POS. NO.	QTY	DESC.	LENGTH	WEIGHT
G308	2	FOR ONE GROUP G308:		
PL322	1	PL 3/4"x1'-3 1/2"	1'-3 1/2"	51.20
PL325	1	PL 1/2"x1'-1"	1'-6"	33.24
ANG326	2	L7x4x1/2	1'-8 3/8"	60.79
C308	1	W8x31	9'-3 3/4"	288.69


BLACK WEIGHT:			416.59	LBS.
GALVANIZED WEIGHT:			17.36	LBS.
TOTAL WEIGHT:			433.95	LBS.

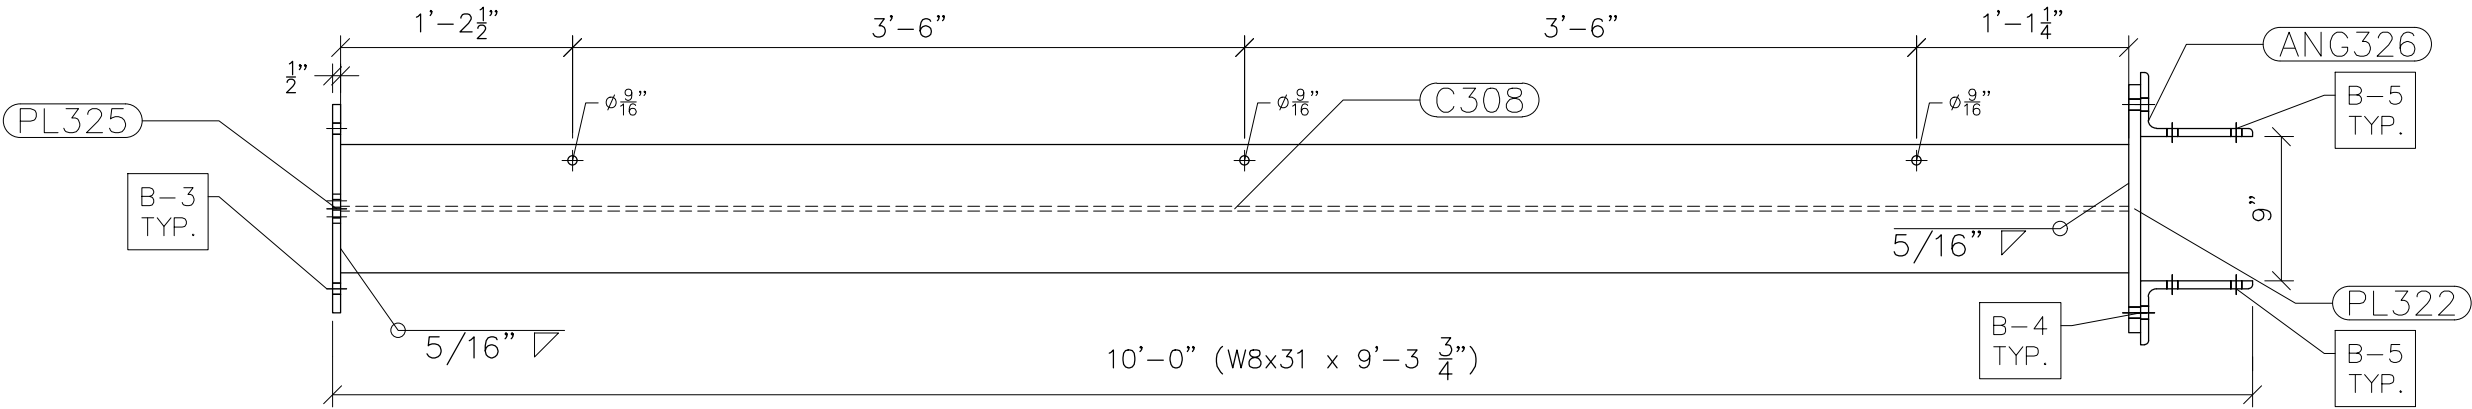


G308 Front View

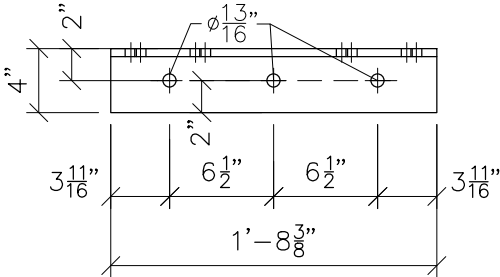

Top View

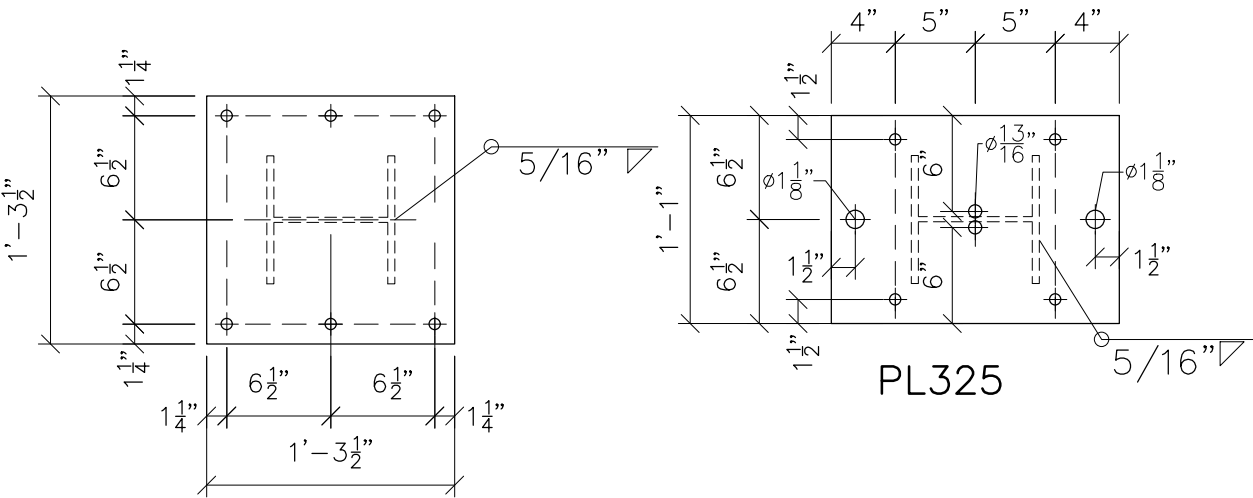

PL322

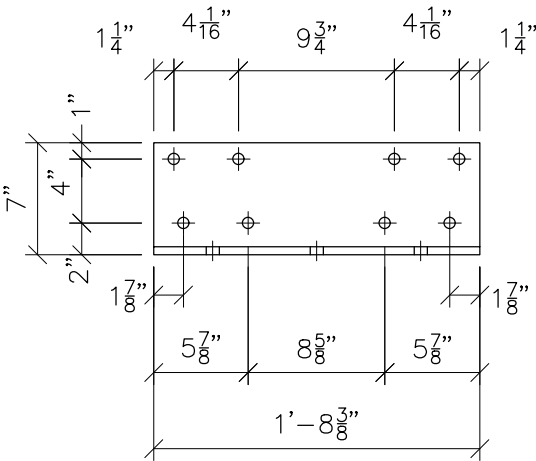

ANG326 Front View

PRELIMINARY - DO NOT USE FOR CONSTRUCTION	NO.	REVISIONS	DATE	PUBLIC WORKS COMMISSION OF THE CITY OF FAYETTEVILLE FAYETTEVILLE, NORTH CAROLINA	
	0	ISSUED FOR BIDS	08/02/21		
				BLACK AND DECKER 69 TO 15 X 25KV SUBSTATION A-FRAME STEEL DETAIL	
				Booth & Associates, LLC <small>5811 Glenwood Avenue Raleigh, NC 27612 CONSULTING ENGINEERS NC F-0221</small>	
				DWN. RLT	DATE: 08/02/21
				CKD. MJM	APPD. MJM
				SCALE: NONE	© 08/21
					DWG. NO. AF-3 12502_A-FRAME

© 08/21